


Hose Valve Header

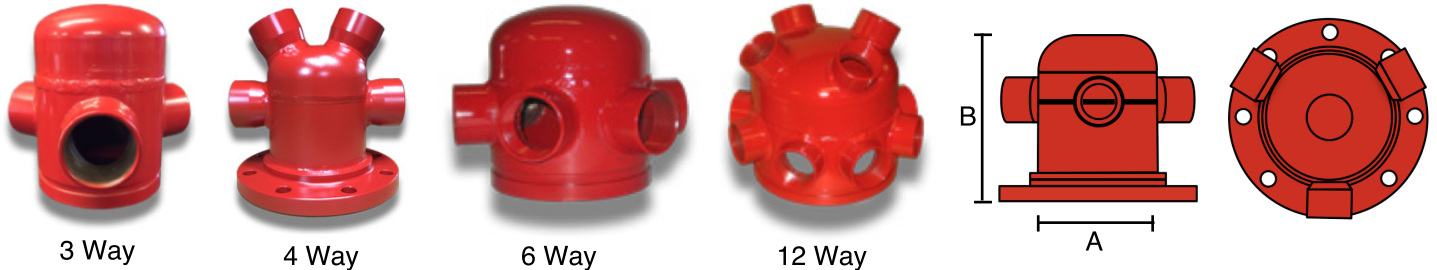

Part No.	Pump Size Max GPM	Outlet Qty.	A	Groove		150# Flange		300# Flange	
				B	Approx. Weight	B	Approx. Weight	B	Approx. Weight
HVX-0301	300	1	3	5.5	4.5	5.5	15.0	5.5	17.0
HVX-0402	500	2	4	8.00	9.7	5.50	20.8	5.88	30.8
HVX-0403	-	3	4	8.00	10.7	5.50	21.8	5.88	31.8
HVX-0603	750	3	6	9.00	18.6	7.00	34.9	7.38	54.9
HVX-0604	1000	4	6	9.00	19.6	7.00	35.9	7.38	55.9
HVX-0606	-	6	6	9.00	21.6	7.00	37.9	7.38	57.9
HVX-0806	2000	6	8	9.5	30.9	8.00	57.8	8.38	87.8
HVX-0808	-	8	8	9.5	32.9	8.00	59.8	8.38	89.8
HVX-1006	2000	6	10	10.50	45.4	9.00	82.8	9.62	120.8
HVX-1008	2500	8	10	10.50	47.4	9.00	84.8	9.62	122.8
HVX-1010	-	10	10	12.13	49.4	10.63	86.8	11.25	124.8
HVX-1012	3000	12	10	12.13	51.4	10.63	88.8	11.25	126.8
HVX-1206	-	6	12	11.50	59.0	10.50	122.3	11.12	176.3
HVX-1208	-	8	12	11.50	61.0	10.50	124.3	11.12	178.3
HVX-1210	2500	10	12	13.13	63.0	12.13	126.3	12.75	180.3
HVX-1212	3500	12	12	13.13	65.0	12.13	128.3	12.75	182.3
HVX-1216	4500	16	12	13.13	69.0	12.13	132.3	12.75	186.3
HVX-1406	750	6	14	12.00	67.5	11.50	153.5	12.12	232.5
HVX-1408	2000	8	14	12.00	69.5	11.50	155.5	12.12	234.5
HVX-1410	2500	10	14	13.63	71.5	13.13	157.5	13.75	236.5
HVX-1412	3500	12	14	13.63	73.5	13.13	159.5	13.75	238.5
HVX-1416	-	16	14	13.63	77.5	13.13	163.5	13.75	242.5

A - Nominal Pipe Size B - End-to-End Dimension

Dimensions listed in inches and approximate weight in pounds.

Submittal Form

www.iowafittings.com

Job Information:	Date:
Architect/Engineer:	Approved as Submitted:
Phone:	
Contractor:	
Address:	
Comments:	